# **C**legrand<sup>®</sup>

## 25A power contactors silent with handle



### 1. DESCRIPTION - USE Symbol:



Technology: . Electromagnetic contactor (monostable relay)

Use: . For controlling a load remotely via a switch

### 2. RANGE

**Conventional thermal current:** . Ith = 25 A

#### Types of contact:

. "NO" contact

#### **Polarities:**

- . 2-pole in 1 module (17.8 mm) "2NO"
- . 4-pole in 2 modules (35.6 mm) "4NO"

## Nominal voltage of the power circuit: . Un = 250 V / 400 V $\sim$

Nominal voltage of the control circuit: . Uc = 24 V et 230 V ~


Nominal frequency of the control and power circuits: . 50 / 60 Hz

### CONTENTS

1.	Description, use1	
2.	Range1	
З.	Dimensions1	
4.	Positioning - Connection1	
5.	General characteristics	
6.	Equipment and accessories6 Compliance and Approvals6	i.
7.	Compliance and Approvals6	i.

PAGES

### 3. DIMENSIONS

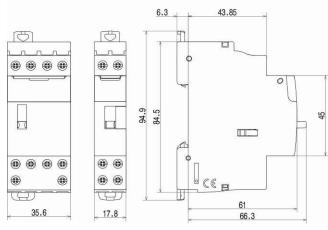

### 4. POSITIONING - CONNECTION

Installation software: . XL PRO

### **Operating position:**

. Vertical, horizontal, flat (all positions)

#### Mounting:

. On symmetrical EN 50-055 rail or DIN 35 rail, using two plastic clips.

#### **Recommended tools:**

. For the terminal screws: insulated or non-insulated screwdriver, Pozidriv no. 1 or with a 4 mm blade.


. For attaching: screwdriver with blade (5.5 mm max) or Pozidriv no. 1.

Length of control lines: . With 24 V contactor: 330 m for 1-module contactor with 1.5 mm<sup>2</sup> . With 230 V contactor: 250 m for 1-module contactor or 400 m for 2-module contactor regardless of the connection cable cross-section.


#### 25A silent power contactors with handle


#### 4. POSITIONING - CONNECTION (continued)

**Positioning in a row:** . The product profile and positioning of the terminals allow single-phase and three-phase toothed connection supply busbars to be passed at the top of the product without impairing accessibility of the contactor terminals. This way it is possible to select the position of the pulse operated latching relay freely in the row and to connect the circuit breakers located on the same rail via a supply busbar.




## Examples of wiring diagrams: . "2 NO" contactor










#### 4. POSITIONING - CONNECTION (continued)

- Labelling: . Marking of the circuits on the front panel with the label holder



#### **Connection:**

- Screw control and power terminals: Type of terminal: caged Depth: 12 mm Capacity (h x w): 4.7 x 4.7 mm Compatible copper conductors

Rigid without ferrule: 1 x (0.75 to 4 mm<sup>2</sup> according to EN/IEC 61095, 6 mm<sup>2</sup> accepted) or 2 x (0.75 to 2.5 mm<sup>2</sup>) Flexible without ferrule: 1 x (0.75 to 6 mm or 2 x (0.75 to 2.5 mm<sup>2</sup>)

Flexible with single ferrule:  $1 \times (0.75 \text{ to } 6 \text{ mm}^2)$ Flexible with double ferrule:  $2 \times (0.75 \text{ to } 4 \text{ mm}^2)$ 

- Screw head: mixed head Pozidriv no. 1 and 4 mm blade Screw head: mixed M3.5
- Min. tightening torque: 0.5 Nm/max.: 1.2 Nm recommended: 0.8 Nm

- Degree of protection: . Terminals protected against direct contact: IP2x (wired device) . Front panel protected against direct contact: IP3XD . Class II, front panel with faceplate . Protection against impacts: IK04

**Resistance to tremors:** . No change in the status of the contacts during the "resistance to tremors" test as defined by the standard EN 60898

- Device handling: . Via remote control (switch).
- . Via ergonomic 3-position handle (I, auto, O).


#### Control status display:

Via orange indicator showing the presence of the control signal or the forced switch-on status

The handle position defines the way the contactor works : "I" position: Forced switch on/ON "O" position: Forced switch off/OFF "Auto" position: Automatic (the contact status depe "Auto" position: Automatic (the contact status depends on the electrical control)

Updated on: 09/07/2020

L<sup>1</sup> legrand

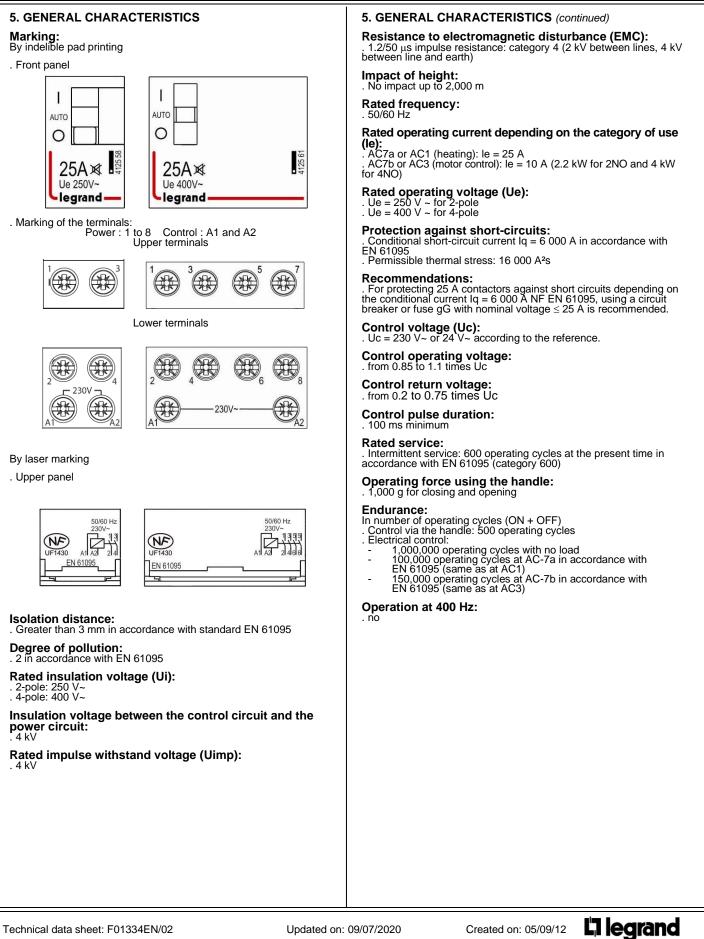

#### 5. GENERAL CHARACTERISTICS (continued)

#### DC usage:

. Control: does not work with DC . Power circuit: NO contacts can be used to control loads supplied with DC in compliance with the derating table below

	DC 1 (resistive load)				3 (motoi		
	Number	of poles i	n series	Number of poles in series			
Ue	1 p	1p 2p 3p		1 p	2 p	3 p	
8 V=	25 A	25 A 25 A 25 A		21.5 A	25 A	25 A	
12 V=	25 A	25 A	25 A	20 A	25 A	25 A	
24 V=	25 A	25 A	25 A	16 A	25 A	25 A	
48 V=	21 A	25 A	25 A	8 A	18 A	25 A	
110 V=	7 A	16 A	25 A	1.6 A	6.5 A	16 A	

#### Control consumption:

Type of contact	Control voltage	Consump (at	tion in mA Un)	
	vollage	Holding	Inrush	
2NO	24 V~	200	970	
2NO	230 V~	12	60	
4NO	230 V~	20	200	
	Control	Consumption in W		

Type of contact	Control voltage	(at Un)
	vollage	Holding
2NO	24 V~	1.4
2NO	230 V~	0.8
4NO	230 V~	1.3

AVERAGE dissipated power via contact at 230 V: . 1.8 W via contact for 25 A contactor

#### Annual consumption of the contactors:

. 230/400V 50Hz network power circuits . Total consumption, control + power, in "standard" usage conditions.

Type of contact	Control voltage	Consumption in KWh (at Un)
2NO	24 V~	4.8
2NO	230 V~	3.1
4NO	230 V~	5.4

#### **Operating temperature:**

A standard contactor is set to function with its nominal current at an ambient temperature of  $+ 30^{\circ}$ C . Operating temperature: from  $- 25^{\circ}$ C to  $+ 40^{\circ}$ C, no derating . Operating temperature: from  $+ 40^{\circ}$ C to  $+ 60^{\circ}$ C, with derating . Derating of contactors assembled in modular boxes if the ambient temperature is  $- 40^{\circ}$ C

- temperature is > 40°C.

Contactor rating	40°C	50°C	60°C
le = 25 A	25 A	22 A	20 A

It is recommended to set up a spacing element (Cat. No. 4 063 07) every 2 contactors.

## Storage temperature: . From - 40°C to +70°C

#### 5. GENERAL CHARACTERISTICS (continued)

#### **Enclosure material:**

. Polyamide

#### Plastic material characteristics:

. Compliance with the resistance to incandescent wire for 30 seconds in accordance with IEC 695-2-1:

- Handle: 650°C - Other parts: 850°C

## Noise on holding:

 $. \leq 30 \text{ dB}$  at 1 cm

## Weight:

Average 0.120 kg per 2-pole device Average 0.230 kg per 4-pole device

#### Packaged volume:

0.2 dm<sup>3</sup> for the 2-pole devices packaged in units
0.4 dm<sup>3</sup> for the 4-pole devices packaged in units

## Contactor selection chart:

For a 10-year service life with 200 days of usage per year

. Heating					
Maximum power depending on the number of operations per day (kW)					
Number of operations per day	≤ 50	75	100	250	500
Single-phase heating 230 V~	5,6	4,4	3,7	2,5	1,25
Three-phase heating 400 V~	16	13,7	11,3	5	3,7
Floor heating			2.3		

#### . Motors (AC-7b)

Maximum power (kW	)
Single phase motor 230 V~	2,3 kW
Three-phase motor 400 V~	4 kW



#### 5. GENERAL CHARACTERISTICS (continued)

#### Contactor selection chart (continued)

. Lighting Maximum number of bulbs per contact of the contactor in 230 V~ single-phase and 400 V~ three-phase + neutral networks . In a 230 V~ three-phase network without neutral the values stated in these tables must be divided by  $\sqrt{3}$ 

- Incandescent bulbs

Low-voltage tungsten 230 V~ and halogen filaments								
Unit power	40 W	60 W	75 W	10	0 W 0			
25 A	60	48	38		30			
		ten 230 V~ ar	nd halogen fila	ments				
Unit power	150 W	200 W	500 W	10	W 00			
25 A	20	15	6		3			
E	ELV halogen	oulbs with ferr	omagnetic bal	last				
Unit power	20 W 3	35 W 50 V	V 75 W	100 W	150 W			
25 A	52	30 24	16	12	8			
ELV halogen bulbs with electronic ballast								
Unit power	20 W 3	35 W 50 V	V 75 W	100 W	150 W			
25 A	80	50 40	26	20	13			

- Fluorescent tubes with ferromagnetic ballast

Single parallel compensated fluorescent tubes with ferromagnetic ballast								
Unit power	18 W	20 W	36 W	58 W	115 W			
25 A	33	30	25	17	9			
					gnetic ballast			
Unit power	2 x 20 W	2 x 36 W	2 x 40 W	2 x 58 V				
25 A	45	38	35	24	10			
Quadruple	series comp	ensated fluc balla			Ũ			
L	Jnit power			4 x 18 W				
	25 A			24				
Compact fluorescent tubes with integrated starter for ferromagnetic ballast								
Unit power	7 W	10 \	N	18 W	26 W			
25 A	60	50		42	28			

#### 5. GENERAL CHARACTERISTICS (continued)

- Fluorescent tubes with electronic ballast

			CUOIN	Dallas	51				
	Single	fluores	scent tu	bes ele	ctronic	balla	st		
Unit power	18 V			W		36 W		58 W	
25 A	110		6	8		58	58 36		
	Double flu	ioresc	ent tube	es with o	electro	nic ba	llast		
Unit power		2 x 18			x 36 W			< 58 W	
25 A		56			30			19	
Triple fluor	escent tub	es wit	th electr	onic ba	llast (s	eries	compen	sated)	
Unit pov		I	3 x 1				3 x 18		
25 A			4				38		
Quadruple flu	orescent	tubes	with ele	ctronic	ballast	(serie	es comp	ensated)	
Unit pov	ver		4 x 1	4 W	201100		4 x 18	W	
25 A		1	3		28				
Compac	t fluoresc	ent tu	oes with	built-in	electr	onic n	ower su	vlaa	
Unit power	7 1		11 W		15 W	2	20 W	23 W	
25 A	20		125			70	60		
- Discharge	lamps w	ith co	mpens	ation					
		Ν	letal ha	logenid	e				
Unit power	35 W			100 W	150	W	250 W	400 W	
25 A	15		9	7	5		3	2	
· · · · ·									
		ow pr	essure	sodium	vapou	ır			
Unit power	18 W	35		55 W	90 V		135 W	180 W	
25 A					5		3	3	
		1	-	-			-		
		-liah p	ressure	sodium	i vapo	ur			
Unit power	70 W		150 W		0 W		W 00	1000 W	
25 A	10		9		6		4	2	
=271									

25 A	10	9	6	4	2			
High pressure mercury vapour								
Unit power	50 W	80 W	125 W	250 W	400 W			
25 A	15	10	8	4	3			
High pressure mixed								
Unit power	100 W	160	W 25	50 W	400 W			
26 A	11	7		5	2			

Led lamps

65

65

65

60

In (A)

25

A

	Led lamps number without driver or not dimmable									
In (A)	2W	5W	7W	9W	12 W	18 W	22 W	30 W	40 W	50 W
25 A	30	30	30	30	30	27	25	22	18	15

Led lamps number with driver or dimmable											
2W	5W	7W	9W	12 W	18 W	22 W	30 W	40 W	50 W		

60

56

51

45

33

30

**L**legrand

#### 6. EQUIPMENT AND ACCESSORIES


#### Auxiliaries:

. NO+NC changeover contact signalling auxiliaries catalogue numbers:

- 4 124 29 and 4 124 30.
- Catalogue number 4 124 29 for 1 module wide 2-pole contactors Catalogue number 4 124 30 for 2 module wide 4-pole contactors Installed to the left of the contactor
- For signaling the position status of the contacts of the product to which it is attached maximum of 2 auxiliaries per contactor


#### Attaching auxiliaries:

. Auxiliaries are installed to the left of the contactors

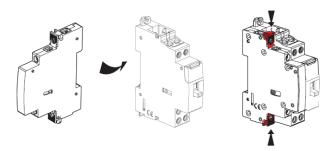


#### . Option of adding two signalling auxiliaries per contactor

- Cat. No. 4 124 29



#### - Cat. No. 4 124 30



#### 7. COMPLIANCE AND APPROVALS

# Compliance with standards: . NF EN 61095/IEC 61095 . NF EN 60947-4-1: AC1 and AC3

Classification in accordance with Appendix Q: (standard IEC/EN 60947-1)

Category F

Inter alia: temperature test range -25°C/+70°C, vibration test 2 Hz to 13.2 Hz with ±1 mm movement, 13.2 Hz to 100 Hz acceleration ±0.7 g, salt spray in accordance with IEC 60068-2-52

#### Respect for the environment - Compliance with **European Union Directives:**

. Compliance with Directive 2002/95/EC of 27/01/03 known as "RoHS" which provides for a restriction on the use of dangerous substances such as lead, mercury, cadmium, hexavalent chromium and polybrominated biphenyl (PBB) and polybrominated diphenyl ether (PBDE) brominated flame retardants from 1st July 2006 . Compliance with the Directive 91/338/EEC of 18/06/91 and decree 94-647 of 27/07/04

#### **Plastic materials:**

- . Plastic material without halogen.
- . Labelling of parts compliant with ISO 11469 and ISO 1043.

#### Packaging:

. Design and manufacture of packaging compliant with decree 98-638 of 20/07/98 and Directive 94/62/EC

#### Approvals obtained:

rance : NF

Technical data sheet: F01334EN/02

L legrand