
Catalogue number(s): 4 125 03 / 04 / 05 / 09 / 10 / 14 / 17 / 21 / 22 / 23 / 24 / 33 / 34 / 35 / 36 / 44 / 51 and 927 02 / 03



CONTENTS	PAGES
Description, use	1 2 3
7. Compliance and Approvals	7

#### 1. DESCRIPTION - USE

#### Symbol:



**Technology:**. Electromagnetic contactor (monostable relay)

. For controlling a load remotely via a switch

#### 2. RANGE


#### **Conventional thermal current:**

. Ith = 16 and 25 A

### Types of contact:

. "NO" contact

. "NC" contact



### Polarities:

- Polarities:
  . 2-pole in 1 module (17.8 mm)
   "2NO"
   "2NC"
   "NO+NC"
  . 4-pole in 2 modules (35.6 mm)
   "4NO"
   "4NC"
   "2NO + 2NC"
   "3NO + 1 NC"

#### 2. RANGE (continued)


Nominal voltage of the power circuit:  $. Un = 250 V/400 V_{\sim}$ 

Nominal voltage of the power circuit: . 24 V and 230  $V_{\sim}$ 

Nominal frequency of the control and power circuits:

#### 3. DIMENSIONS

Updated: 09/07/20

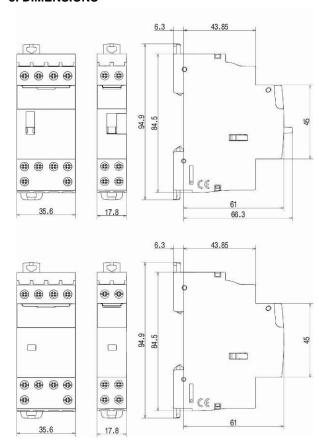

Catalogue number(s): 4 125 03 / 04 / 05 / 09 / 10 / 14 / 17 / 21 / 22 / 23 / 24 / 33 / 34 / 35 / 36 / 44 / 51 and 927 02 / 03

#### 4. POSITIONING - CONNECTION

## **Installation software:** . XL PRO


Operating position:
. Vertical, horizontal, flat (all positions)

On symmetrical EN 50-055 rail or DIN 35 rail, using two plastic clips.


Recommended tools:
. For the terminal screws: insulated or non-insulated screwdriver, Pozidriv no. 1 or with a 4 mm blade.
. For attaching: screwdriver with blade (5.5 mm max) or Pozidriv

Positioning in a row:

The product profile and positioning of the terminals allow single-phase and three-phase toothed connection supply busbars to be passed at the top of the product without impairing accessibility of the contactor terminals. This way it is possible to select the position of the pulse operated latching relay freely in the row and to connect the circuit breakers located on the same rail via a supply busbar.




## Examples of schematic diagrams: . "2 NO" contactor

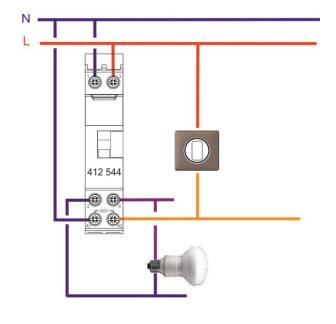


### 4. POSITIONING - CONNECTION (continued)

. "4NO used as a 3NO" contactor

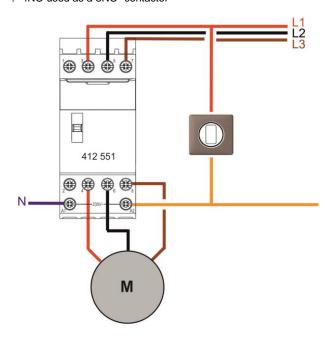

. "4 NO" contactor

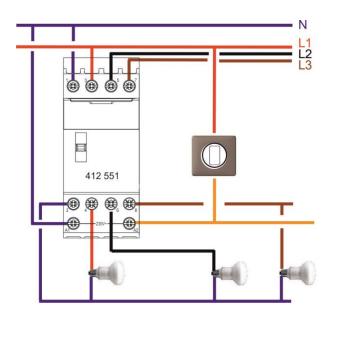

Catalogue number(s): 4 125 03 / 04 / 05 / 09 / 10 / 14 / 17 / 21 / 22 / 23 / 24 / 33 / 34 / 35 / 36 / 44 / 51 and

### 4. POSITIONING - CONNECTION (continued)

#### Connection:

- Screw control and power terminals:
   Type of terminal: caged

- Depth: 12 mm
   Capacity (h x w): 4.7 x 4.7 mm
   Compatible copper conductors

- Compatible copper conductors
Rigid without ferrule:

1 x (0.75 to 4 mm² according to EN/IEC 61095, 6 mm² accepted)
or 2 x (0.75 to 2.5 mm²)
Flexible without ferrule: 1 x (0.75 to 6 mm) or 2 x (0.75 to 2.5 mm²)
Flexible with single ferrule: 1 x (0.75 to 6 mm²)
Flexible with double ferrule: 2 x (0.75 to 4 mm²)
- Screw head: mixed head Pozidriv no. 1 and 4 mm blade
- Screw head: mixed M3.5
- Min\_tightening\_torque: 0.5 Nm/max: 1.2 Nm\_recommender

Min. tightening torque: 0.5 Nm/max.: 1.2 Nm recommended: 0.8 Nm

**Length of control lines:**. with 24 V contactor: 330 m for 1-module contactor or 100 m for 2-module contactor with 1.5 mm² cables
. with 230 V contactor: 250 m for 1-module contactor or 400 m for 2-module contactor regardless of the connection cable crosssection.

Degree of protection:

Terminals protected against direct contact: IP2x (wired device)
 Front panel protected against direct contact: IP3XD
 Class II, front panel with faceplate
 Protection against impacts: IK04

#### Resistance to tremors:

. No change in the status of the contacts during the "resistance to tremors" test as defined by the standard EN 60898

**Device handling:**. Via remote control (switch).
. Via ergonomic 3-position handle (I, auto, O) if the product is fitted with one.

**Control status display:** Via orange indicator showing the presence of the control signal or


the forced switch-on status

For contactors with a handle the position of the latter provides the following indications:

"I" position: Forced switch on/ON
"O" position: Forced switch off/OFF

"Auto" position: Automatic (the contact status depends on the electrical control)


Labelling:
. Marking of the circuits on the front panel with the label holder




#### 5. GENERAL CHARACTERISTICS

**Marking:** By indelible pad printing

. Front panel






. Marking of the terminals: Power: 1 to 8 Co Control: A1 and A2 Upper terminals





Lower terminals






#### By laser marking

. Upper panel





**Isolation distance:** . Greater than 3 mm in accordance with standard EN 61095

### Rated insulation voltage (Ui):

. 1-pole/ 2-pole/ 3-pole/ 4-pole: 440 V~

#### Degree of pollution:

2 in accordance with EN 61095

Insulation voltage between the control circuit and the power circuit: . 4 kV

Created on: 31/07/12

Catalogue number(s): 4 125 03 / 04 / 05 / 09 / 10 / 14 / 17 / 21 / 22 / 23 / 24 / 33 / 34 / 35 / 36 / 44 / 51 and 927 02 / 03

#### 5. GENERAL CHARACTERISTICS (continued)

#### Rated impulse withstand voltage (Uimp):

#### Resistance to electromagnetic disturbance (EMC):

1.2/50 μs impulse resistance: category 4 (2 kV between lines, 4 kV between line and earth)

#### Impact of height:

. No impact up to 2,000 m

#### Rated frequency:

## Rated operating current depending on the category of use

(le):
. AC7a or AC1 (heating): le = 16 A or 25 A depending on the

catalogue numbers
. AC7b or AC3 (motor control): le = 10 A (2.2 kW for 2NO and 4 kW for 4NO) for the 25 A contactors and le = 6.5 A for the 16 A contactors

# Rated operating voltage (Ue): . Ue = $250 \text{ V} \sim \text{for } 1/2\text{-pole}$ . Ue = $400 \text{ V} \sim \text{for } 3/4\text{-pole}$

Protection against short-circuits:
. Conditional short-circuit current Iq = 6 000 A in accordance with EN 61095

. Permissible thermal stress: 16 000 A<sup>2</sup>s

#### Recommendations:

. For protecting 16 A and 25 A contactors against short circuits depending on the conditional current Iq = 6 000 A NF EN 61095, using a circuit breaker or fuse gG with nominal voltage  $\leq$  25 A is

## Control voltage (Uc): . Uc = 230 V~ or 24 V~

## Control operating voltage: . from 0.85 to 1.1 times Uc

#### Control return voltage:

. from 0.2 to 0.75 times Uc

#### Control pulse duration:

#### Rated service:

. Intermittent service: 600 operating cycles at the present time in accordance with EN 61095 (category 600)

# Operating force using the handle: 1,000 g for closing and opening Endurance:

In number of operating cycles (ON + OFF)
. Control via the handle: 500 operating cycles

- Electrical control:
   1,000,000 operating cycles with no load
   100,000 operating cycles at AC-7a in accordance with EN 61095 (same as at AC1)

   1,000,000 operating cycles at AC1 or AC 7b in accordance with

150,000 operating cycles at AC-7b in accordance with EN 61095 (same as at AC3)

#### Operation at 400 Hz:

### 5. GENERAL CHARACTERISTICS (continued)

DC usage:

. Control: does not work with DC
. Power circuit: NO contacts and NC contacts can be used to control loads supplied with DC in compliance with the derating table below

loads supplied with both compilation with the defating table below								
	DC 1 (resistive load)			DC 3 (m	otors)			
	Number of poles in series			Number of poles in serie				
Ue	1 p	2 p	3 p	1 p	2 p	3 p		
8 V=	25 A	25 A	25 A	21.5 A	25 A	25 A		
12 V=	25 A	25 A	25 A	20 A	25 A	25 A		
24 V=	25 A	25 A	25 A	16 A	25 A	25 A		
48 V=	21 A	25 A	25 A	8 A	18 A	25 A		
110 \/-	7 A	16 A	25 A	16A	6 5 A	16 A		

**Control consumption** 

Control consum								
Type of contact	Control voltage	Consumption in mA (at Un)						
*'	voltage	Holding	Inrush					
2NO/NC+NO	24 V~	200	970					
4NO	24 V~	300	2500					
2NO		12	60					
2NC	230 V~	20	90					
NC+NO	230 V~	20	90					
4NO		20	200					

Type of contact	Control voltage	Consumption (at Un) Holding	in	W
2NO/NC+NO	24 V~	1.4		
4NO		2.1		
2NO		0.8		
2NC	230 V~	1.2		
NC+NO	230 V~	1.2		
4NO		1.3		

# AVERAGE dissipated power via contact at 230 V: . 0.8 W via contact for 16 A contactor . 1.8 W via contact for 25 A contactor

#### Annual consumption of the contactors:

230/400V 50Hz network power circuits

Total consumption, control + power, in "standard" usage conditions.

Type of contact	Control voltage	Consumption in KWh (at Un)
NC+NO		4
2NO	24 V~	4.8
4NO		7.6
2NO		3.1
2NC		1.0
NC+NO	230 V~	3.4
4NO	230 V~	5.4
4NC		2.0
2NC+2NO		4.4

Catalogue number(s): 4 125 03 / 04 / 05 / 09 / 10 / 14 / 17 / 21 / 22 / 23 / 24 / 33 / 34 / 35 / 36 / 44 / 51 and 927 02 / 03

#### 5. GENERAL CHARACTERISTICS (continued)

**Noise on holding:** . Traditional contactor: ≤ 45 dB at 1 cm

Operating temperature:

. A standard contactor is set to function with its nominal current at an ambient temperature of + 30°C

. In order to limit overheating the recommendation is to insert a spacing element (Cat. No. 406 307)

- every 2 contactors if the ambient temperature  $\leq$  40°C

- for every contactor if the ambient temperature is > 40°C

. The following derating needs to be applied depending on the ambient temperature values:

- from - 25°C to + 40°C, no derating

- from + 40°C to + 60°C with the derating below

Contactor rating	40°C	50°C	60°C
le = 16 A	16 A	14 A	13 A
le = 25 A	25 A	22 A	20 A

## Storage temperature: . From - 40°C to +70°C

#### **Enclosure material:**

. Polyamide

### Plastic material characteristics:

- . Compliance with the resistance to incandescent wire for 30 seconds in accordance with IEC 695-2-1:
   Handle: 650°C
- Other parts: 850°C

#### Weight:

le = 16/25 A Average 0.120 kg per 1-pole and 2-pole device average 0.230 kg per 4-pole device

#### Packaged volume:

. 0.2 dm<sup>3</sup> for the 1-pole and 2-pole devices packaged in units . 1.6 dm<sup>3</sup> for the 1-pole and 2-pole devices packaged in packs of 10

. 0.4 dm³ for the 4-pole devices packaged in units

#### Contactor selection chart:

For a 10-year service life with 200 days of usage per year . Heating

Maximum power depending on the number of operations per day (kW)						
Number of operations per	day	≤ 50	75	100	250	500
Single-phase heating	16 A	3,6	2.8	2.4	1.6	0.8
230 V~	25 A	5,6	4.4	3.7	2.5	1.25
Three-phase heating 400 V~	25 A	16	13.7	11.3	5	3.7
Floor heating	16 A			1.5		
1 loor fleating	25 A			2.3		

. Motors (AC-7b)

Maximum power (kW)		
Single phase motor	16 A	1.5
230 V~	25 A	2.3
Three-phase motor 400 V~	25 A	4

### 5. GENERAL CHARACTERISTICS (continued)

. Lighting Maximum number of bulbs per contact of the contactor in 230 V~ single-phase and 400 V~ three-phase + neutral networks . In a 230 V~ three-phase network without neutral the values stated in these tables must be divided by  $\sqrt{3}$ 

- Incandescent bulbs

Low-voltage to	ungsten 230 V~	and halogen f	ilaments	
Unit power	40 W	60 W	75 W	100 W
16 A	45	30	24	19
25 A	60	48	38	30

Low-voltage tungsten 230 V~ and halogen filaments						
Unit power	150 W	200 W	500 W	1000 W		
16 A	13	10	4	2		
25 A	20	15	6	3		

ELV halogen b	ulbs with	erromagn	etic ballas	t		
Unit power	20 W	35 W	50 W	75 W	100 W	150 W
16 A	32	20	15	12	9	6
25 A	52	30	24	16	12	8

ELV halogen b	ulbs with e	electronic	ballast			
Unit power	20 W	35 W	50 W	75 W	100 W	150 W
16 A	60	40	28	18	14	9
25 A	80	50	40	26	20	13

- Fluorescent tubes with ferromagnetic ballast

Single parall	el compens	sated fluore	escent tube	s with	ferromagnetic
Unit power	18 W	20 W	36 W	58 W	115 W
16 A	24	24	16	11	5
25 A	33	30	25	17	9

Double series compensated fluorescent tubes with ferromagnetic ballast							
Unit power	2 x 20 W	2 x 36 W	2 x 40 W	2 x 58 W	2 x 140		
16 A	30	24	22	15	6		
25 A	45	38	35	24	10		

Quadruple ballast	series	compensated	flu	orescent	tubes	with	ferromagnetic
Unit power				4 x 18 V	V		
16 A				16			
25 A				24			

Compact flue ballast	orescent	tubes with integra	for ferromagnetic	
Unit power	7 W	10 W	18 W	26 W
16 A	50	40	28	19
25 A	60	50	42	28



Catalogue number(s): 4 125 03 / 04 / 05 / 09 / 10 / 14 / 17 / 21 / 22 / 23 / 24 / 33 / 34 / 35 / 36 / 44 / 51 and 927 02 / 03

#### 5. GENERAL CHARACTERISTICS (continued)

- Fluorescent tubes with electronic ballast

Single fluorescent tubes electronic ballast						
Unit power	18 W	30 W	36 W	58 W		
16 A	72	42	36	22		
25 A	110	68	58	36		

Double fl	Double fluorescent tubes with electronic ballast						
Unit power	er 2 x 18 W	2 x 36 W	2 x 58 W				
16 A	36	20	12				
25 A	56	30	19				

Triple fluorescent tubes with electronic ballast (series compensated)							
Unit power	3 x 14 W	3 x 18 W					
16 A	34	26					
25 A	46	38					

Quadruple fluorescent tubes with electronic ballast (series compensated)							
Unit power	4 x 14 W	4 x 18 W					
16 A	26	20					
25 A	37	28					

Compact fluorescent tubes with built-in electronic power supply							
	Unit power	7 W	11 W	15 W	20 W	23 W	
	16 A	120	80	64	50	43	
	25 A	200	125	90	70	60	

- Discharge lamps with compensation

Metal halogenide						
Unit power	35 W	70 W	100 W	150 W	250 W	400 W
16 A	10	6	5	3	2	1
25 A	15	9	7	5	3	2

Low pressure	sodium vapour					
Unit power	18 W	35 W	55 W	90 W	135 W	180 W
16 A	12	6	5	3	2	2
25 A	20	10	7	5	3	3

High pressur	High pressure sodium vapour							
Unit power	70 W	150 W	250 W	400 W	1000 W			
16 A	8	7	5	3	1			
25 A	10	9	6	4	1 2			

High pressure mercury vapour								
Unit power	50 W	80 W	125 W	250 W	400 W			
16 A	11	8	6	3	2			
25 A	15	10	8	4	3			

High pressure mixed							
Unit power	100 W	160 W	250 W	400 W			
16 A	9	6	4	2			
25 A	11	7	5	3			

ELV halogen bulbs with electronic ballast									
Unit power	20 W	35 W	50 W	75 W	100 W	150 W			
16 A	60	40	28	18	14	9			
25 A	80	50	40	26	20	13			

#### 5. GENERAL CHARACTERISTICS (continued)

- Led lamps

	Led lamps number without driver or not dimmable									
In (A)	2W	5W	7W	9W	12 W	18 W	22 W	30 W	40 W	50 W
16 A	16	16	16	16	16	15	14	12	10	9
25 A	30	30	30	30	30	27	25	22	18	15


	Led lamps number with driver or dimmable									
In (A)	2W	5W	7W	9W	12 W	18 W	22 W	30 W	40 W	50 W
16 A	40	40	40	35	35	33	30	27	23	20
25 A	65	65	65	60	60	56	51	45	33	30


#### 6. EQUIPMENT AND ACCESSORIES

- Auxiliaries:
  NO+NC changeover contact signalling auxiliaries catalogue numbers:
  4 124 29 and 4 124 30.
   Catalogue number 4 124 29 for 1 module wide 2-pole contactors
   Catalogue number 4 124 30 for 2 module wide 3 and 4-pole contactors
- Cottaining of the contactor Installed to the left of the contactor For signalling the position status of the contacts of the product to which it is attached maximum of 2 auxiliaries per contactor

#### Attaching auxiliaries:

Auxiliaries are installed to the left of the contactors






La legrand

Catalogue number(s): 4 125 03 / 04 / 05 / 09 / 10 / 14 / 17 / 21 / 22 / 23 / 24 / 33 / 34 / 35 / 36 / 44 / 51 and 927 02 / 03


#### 6. EQUIPMENT AND ACCESSORIES (continued)

Attaching auxiliaries (continued):

. Option of adding two signalling auxiliaries per contactor - Cat. No. 4 124 29



- Cat. No. 4 124 30



#### 7. COMPLIANCE AND APPROVALS

# **Compliance with standards:**. NF EN 61095/IEC 61095 . NF EN 60947-4-1: AC1 and AC3

- Classification in accordance with Appendix Q:  $(\mbox{standard IEC/EN }60947\mbox{-}1)$
- . Category F

Inter alia: temperature test range -25°C/+70°C, vibration test 2 Hz to 13.2 Hz with  $\pm 1$  mm movement, 13.2 Hz to 100 Hz acceleration  $\pm 0.7$  g, salt spray in accordance with IEC 60068-2-52

### Respect for the environment - Compliance with **European Union Directives:**

- . Compliance with Directive 2002/95/EC of 27/01/03 known as "RoHS" which provides for a restriction on the use of dangerous substances such as lead, mercury, cadmium, hexavalent chromium and polybrominated biphenyl (PBB) and polybrominated diphenyl ether (PBDE) brominated flame retardants from 1st July 2006
- . Compliance with the Directive 91/338/EEC of 18/06/91 and decree 94-647 of 27/07/04

#### Plastic materials:

- . Plastic material without halogen.
- . Labelling of parts compliant with ISO 11469 and ISO 1043.

#### Packaging:

. Design and manufacture of packaging compliant with decree 98-638 of 20/07/98 and Directive 94/62/EC

### Approvals obtained:

. France: NF

**La** legrand